


17:29:16

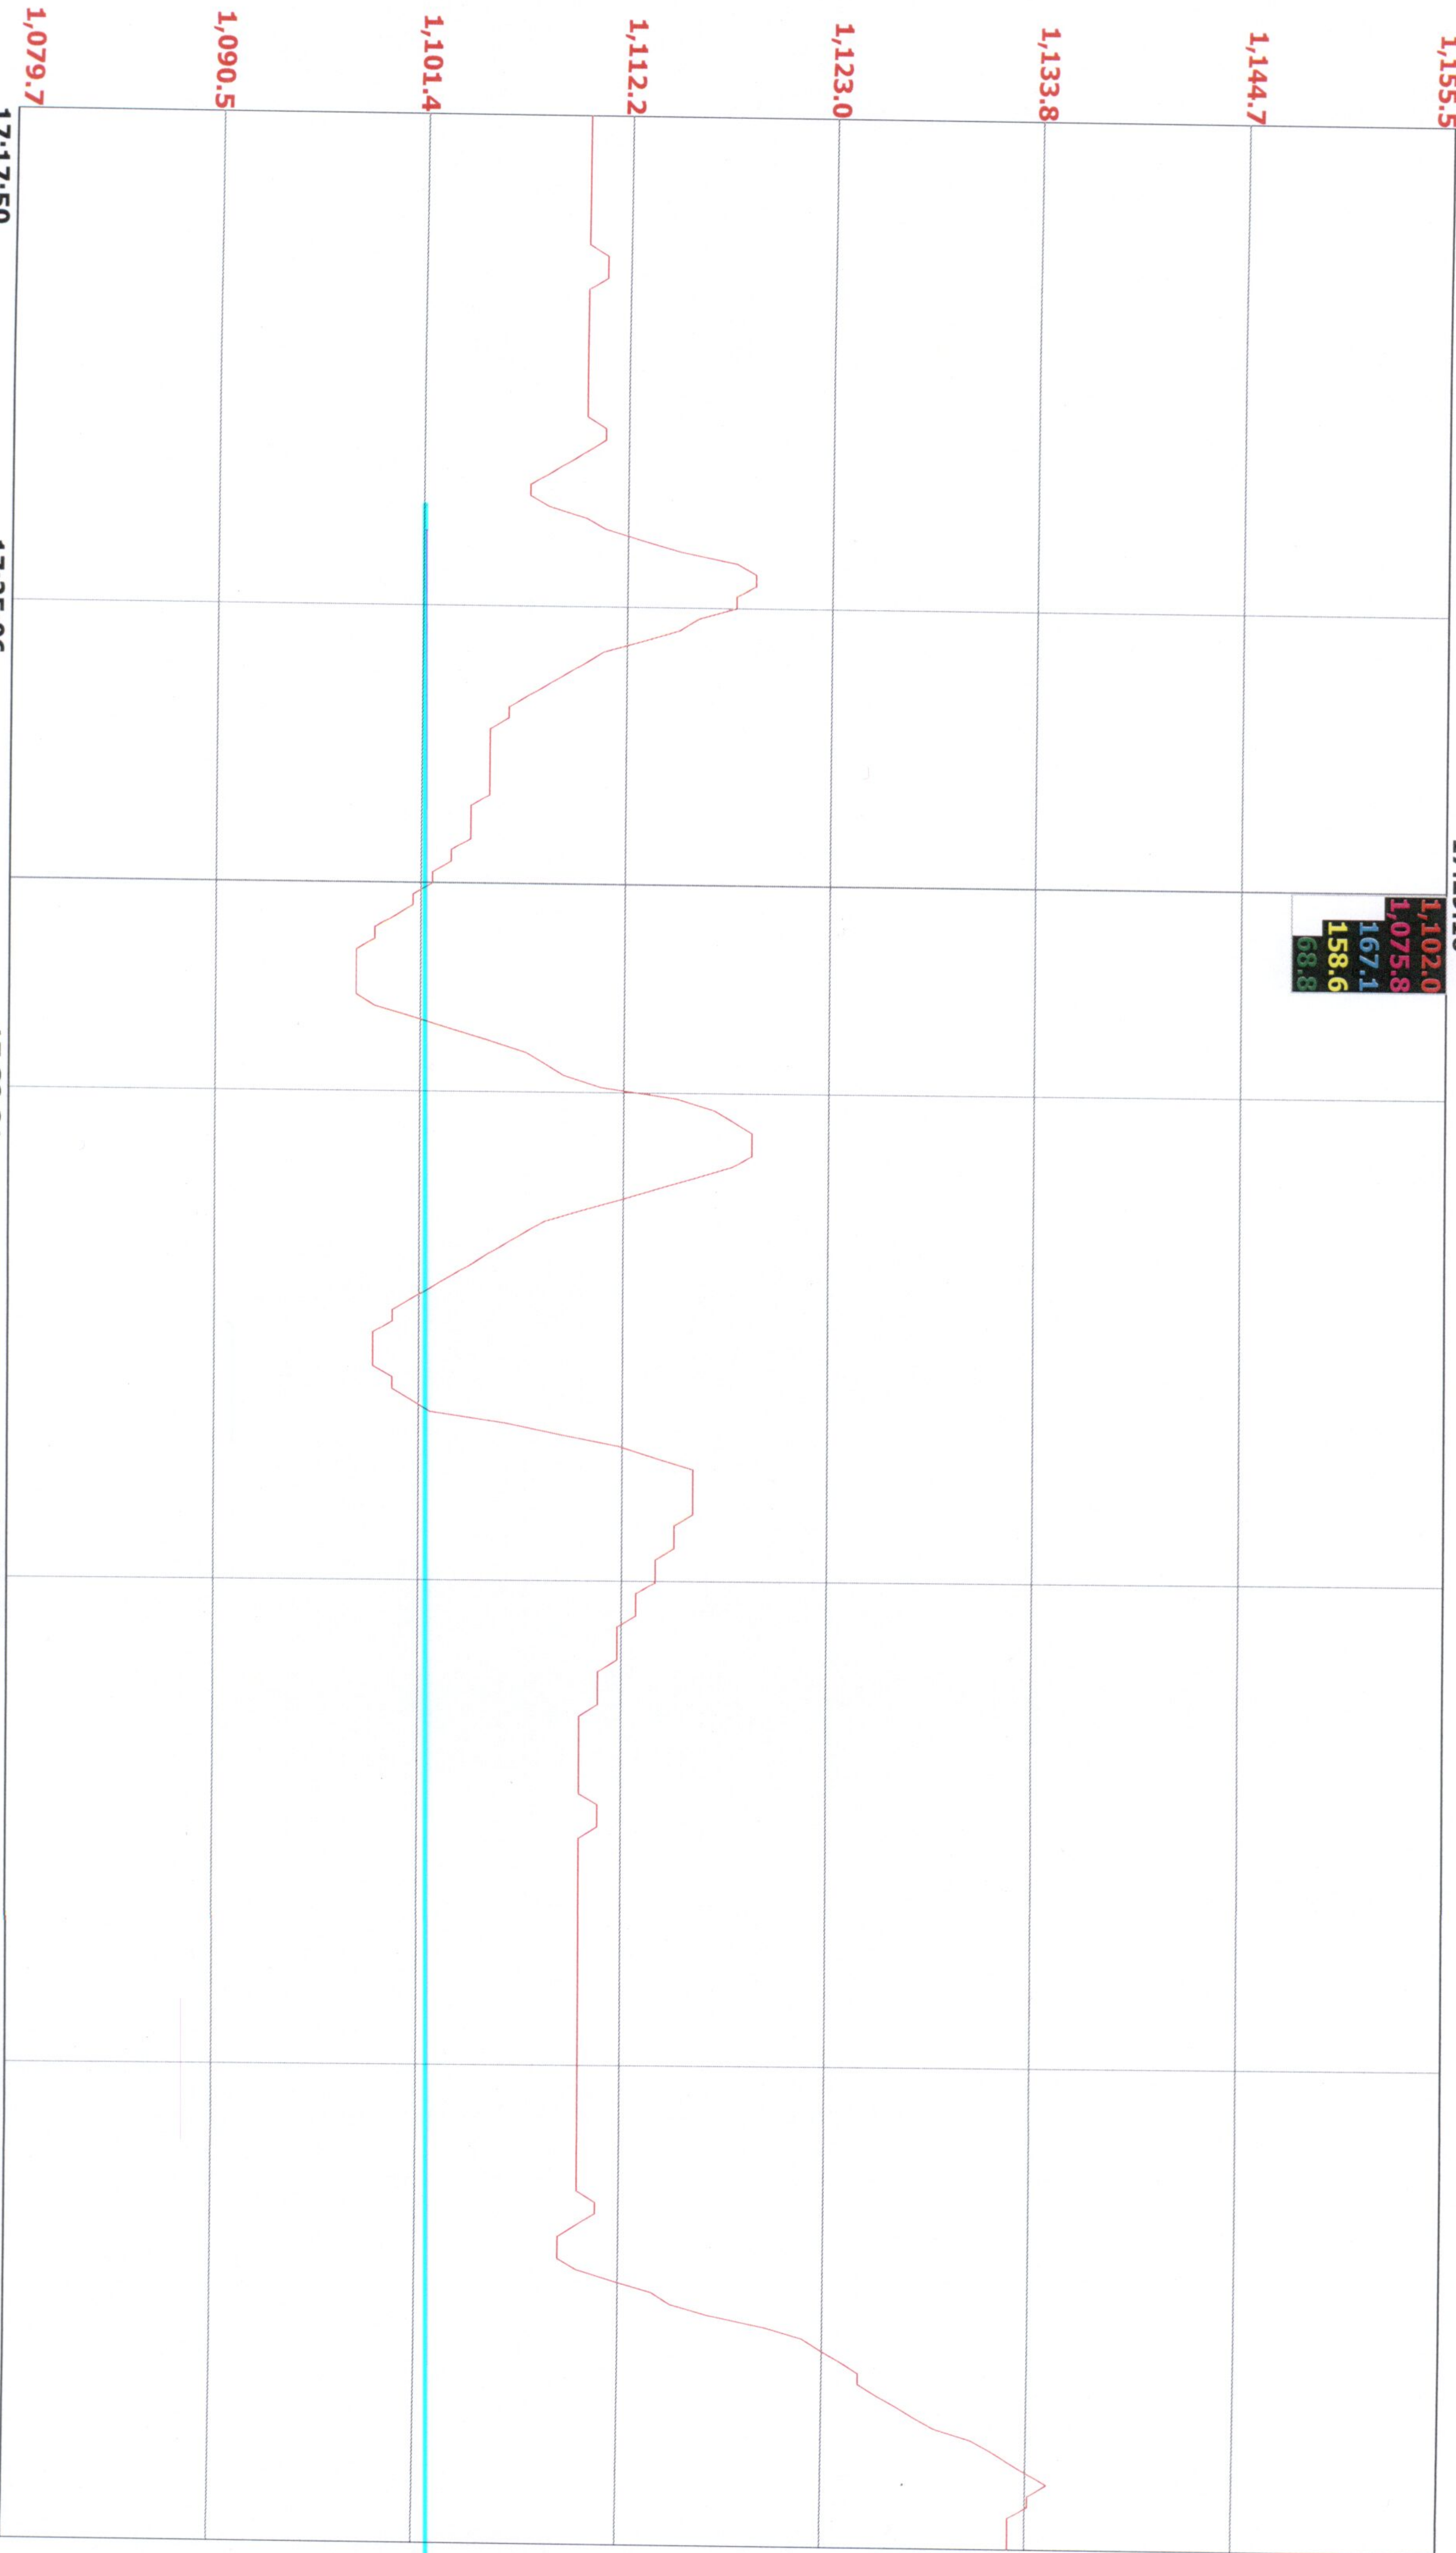

17:17:50		17:25:06	17:32:21	17:39:36		17:46:52	17:54:07
Caption		13:38:46	Min	Max	Units		
Stream 1 - Secondary Combustion Chamber 1 Temperature, TT2300_1		1,112.0	1,079.7	1,155.5C			
Stream 1 Secondary Combustion Outlet Temperature, TT3314_1		1,083.1	925.5	990.4C			
Stream 1 - Boiler Discharge Temperature, TT4300_1		180.0	231.4	247.6C			
Stream 1 Waste Heat Boiler Outlet Temperature, TT3315_1		177.7	925.5	990.4C			
Bag Filter Inlet Temperature Stream 1, TT4303_1		172.3	231.4	247.6C			
Stream 1 Flue Gas Recirculation Temperature, TT2302_1		62.4	231.4	247.6C			
Not Configured		0.0	231.4	247.6-			
Not Configured		???	231.4	247.6-			