


03:39:59

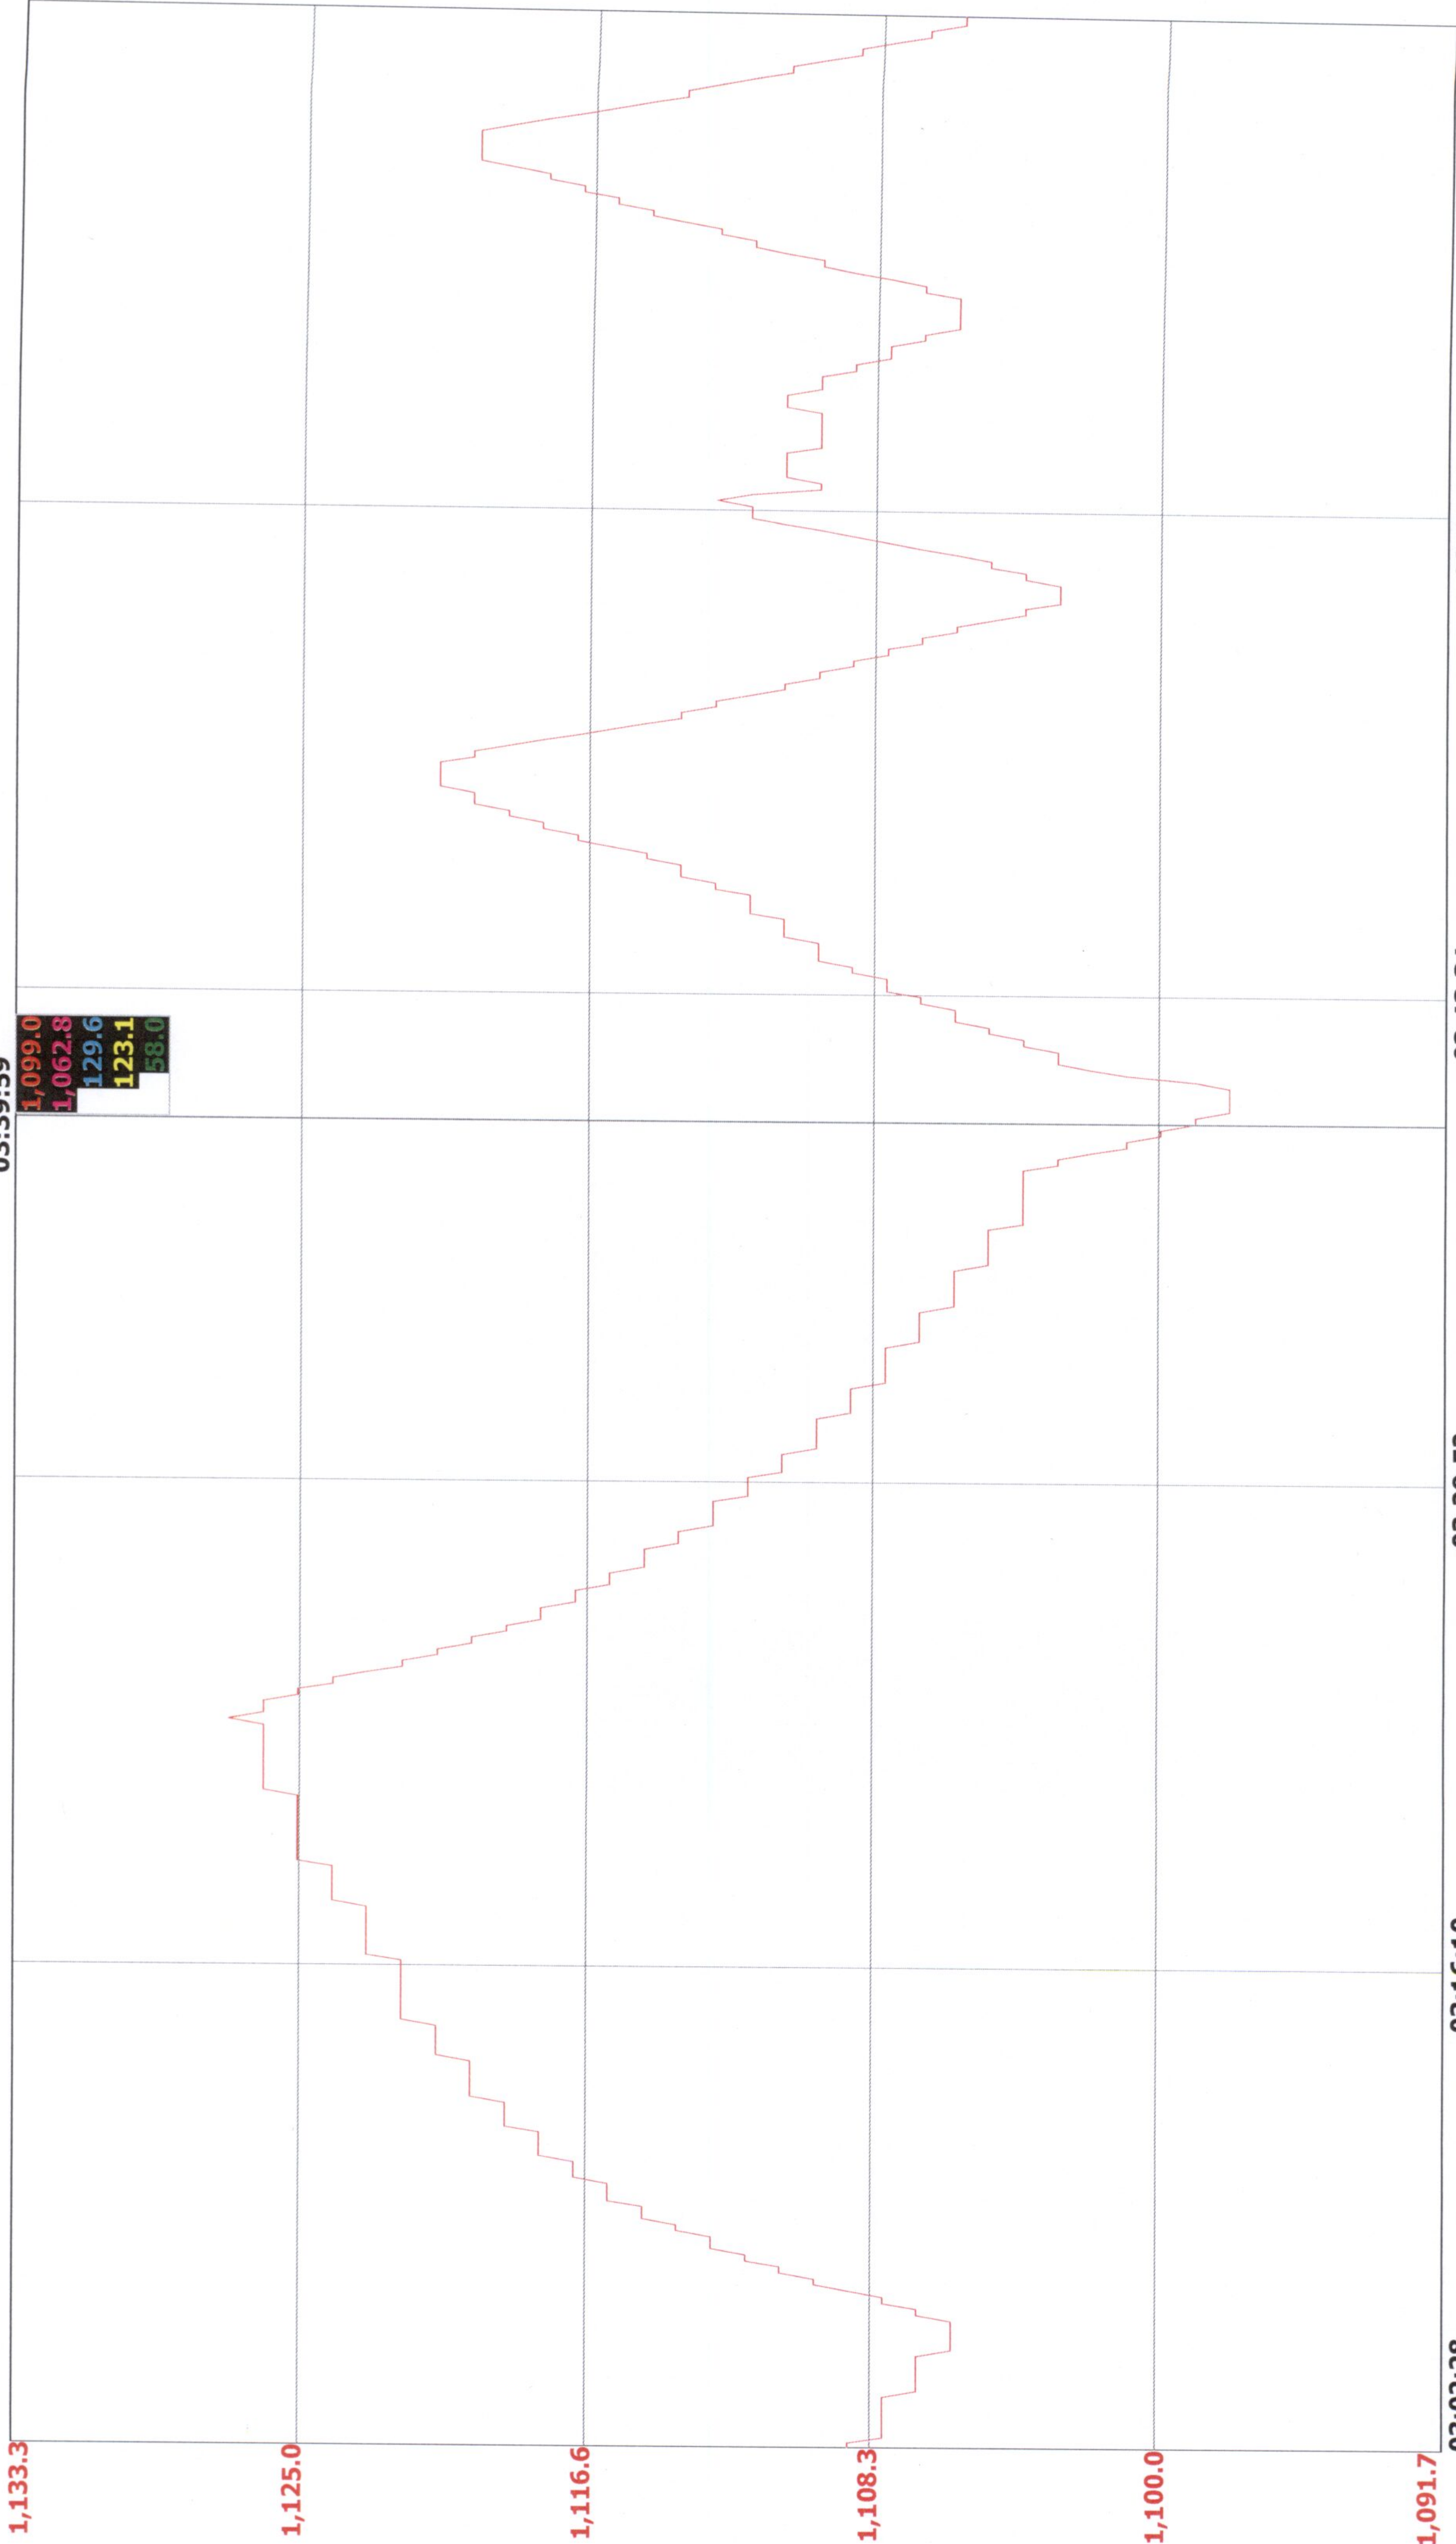

03:02:28		03:16:10		03:29:52		03:43:34		03:57:16		04:10:58	
		Caption		11:30:01		Min		Max		Units	
	Stream 1 - Secondary Combustion Chamber 1 Temperature, TT2300_1			650.0		1,091.7		1,133.3C			
	Stream 1 Secondary Combustion Outlet Temperature, TT3314_1			605.3		935.8		971.4C			
	Stream 1 - Boiler Discharge Temperature, TT4300_1			71.0		233.9		242.8C			
	Stream 1 Waste Heat Boiler Outlet Temperature, TT3315_1			82.1		935.8		971.4C			
	Bag Filter Inlet Temperature Stream 1, TT4303_1			86.4		233.9		242.8C			
	Stream 1 Flue Gas Recirculation Temperature, TT2302_1			47.8		233.9		242.8C			
	Not Configured			0.0		233.9		242.8-			
	Not Configured			???		233.9		242.8-			